Transformers

GENERAL SPECIFICATIONS

☐ AT50



This transformer with mounting plate for a standard 4 x 4 outlet box is used in HVAC applications.

Electrical Ratings:

Primary Voltage

- ☐ 240/480V ac, 50/60 Hz
- 277V ac, 50/60 Hz Secondary voltage:
- ☐ 17/24 V ac at 50 VA

Connections:

Primary: 8-in. (203-mm) leadwires Secondary: 18-in. (457-mm) leads

Approval Bodies:

Underwriters Laboratories (UL) listed

Dimensions:

See Figure 1.


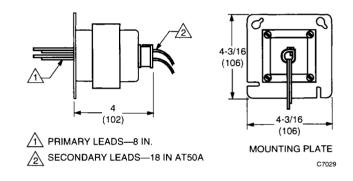


Fig. 1. AT50 Approximate Dimensions in Inches (Millimeters).



□ AT72D



Connections:

Primary: 9-in. (229-mm) leadwires Secondary:

- ☐ 9-in. (229-mm) leads
- 32-in. (800-mm) leads
- Screw terminals

Approval Bodies:

Underwriters Laboratories (UL) listed Canadian Standards Association (CSA) Approved

Dimensions:

See Figure 2.

This Class Z stepdown transformer with mounting plate for a standard 4 x 4 outlet box is used in HVAC applications. It has an internal fusible link for overload protection.

Electrical Ratings:

Primary Voltage

- ☐ 120V ac, 50/60 Hz
- □ 208V ac, 50/60 Hz
- ☐ 220V ac, 50 Hz
- □ 220V ac, 50/60 Hz
- ☐ 240V ac, 50/60 Hz
- 208/2240V ac, 50/60 Hz

Secondary voltage:

☐ 24 V ac at 39 VA





Fig. 2. AT72D Approximate Dimensions in Inches (Millimeters).

□ AT74A



This rugged, heavy duty general purpose transformer without overload protection is used in HVAC applications. It includes a mounting plate for a standard 4 x 4 outlet box.

Electrical Ratings:

Primary Voltage

- 120V ac, 50/60 Hz
- 208V ac, 50/60 Hz
- ☐ 240V ac, 50/60 Hz

Secondary voltages:

- ☐ 18V ac at 65 VA
- 20V ac at 80 VA
- ☐ 24V ac at 100 VA

Connections:

Primary: Leadwires

Secondary: Thumb screws

Approval Bodies:

Underwriters Laboratories (UL) listed Canadian Standards Association (CSA) Approved

Dimensions:

See Figure 3.


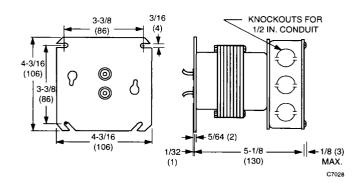


Fig. 3. AT74A and B Approximate Dimensions in Inches (Millimeters).

□ AT74B



This rugged, heavy duty general purpose transformer with replaceable overload protection is used in HVAC applications. It includes a mounting plate for a standard 4 x 4 outlet box.

Electrical Ratings:

Primary Voltage

- ☐ 120V ac, 50/60 Hz Secondary voltages:
- ☐ 18V ac at 3A
- 20V ac at 3A
- 24V ac at 3A

Connections:

Primary: Leadwires

Secondary: Thumb screws

Approval Bodies:

Underwriters Laboratories (UL) listed Canadian Standards Association (CSA) Approved

Dimensions:

See Figure 3.

☐ AT74C



RC3

Electrical Ratings:

Primary Voltage

- ☐ 120V ac, 50/60 Hz Secondary voltages:
- 20V ac at 80 VA
- ☐ 24V ac at 96 VA
- 28V ac at 84 VA

Connections:

Primary: Leadwires

Secondary: Thumb screws

Approval Bodies:

Underwriters Laboratories (UL) listed Canadian Standards Association (CSA) Approved

Dimensions:

See Figure 4.

This rugged, heavy duty general purpose transformer without overload protection is used in HVAC applications. It is foot mounted.


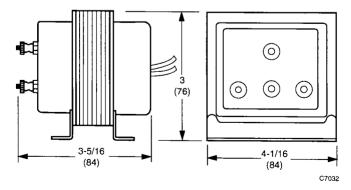


Fig. 4. AT74C Approximate Dimensions in Inches (Millimeters).

□ AT87A



This Class 2, energy limited, transformer without overload protection is used in HVAC applications. It includes a mounting plate for a standard 4 x 4 outlet box.

Electrical Ratings:

Primary Voltage

- ☐ 120V ac, 50/60 Hz
- ☐ 240V ac, 50/60 Hz
- ☐ 277V ac, 50 Hz

- ☐ 120/208/2240V ac, 50/60 Hz
- 208/240V ac, 50/60 Hz Secondary voltages:
- ☐ 20V ac at 80 VA
- 24V ac at 96 VA
- 28V ac at 84 VA

Connections:

Primary: Leadwires

Secondary: Screws terminals

Approval Bodies:

Underwriters Laboratories (UL) listed Canadian Standards Association (CSA) Approved

Dimensions:

See Figure 5.


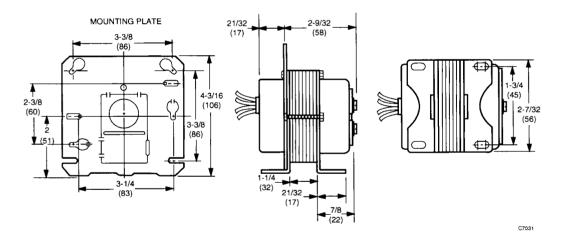


Fig. 5. AT87A Approximate Dimensions in Inches (Millimeters).

4

74-3277

□ AT92A



This Class 1 Type A transformer is used in HVAC applications. The core and coils are potted in a heavy sheet metal box.

Electrical Ratings:

Primary Voltage

- ☐ 120/240/480V ac, 50/60 Hz Secondary voltages:
- ☐ 17V ac at 70 VA
- ☐ 24V ac at 100 VA

Connections: (See Fig. 7 for schematic)

Primary: Leadwires Secondary: Leadwires

Approval Bodies:

Underwriters Laboratories (UL) listed Canadian Standards Association (CSA) Approved

Dimensions:

See Figure 6.




Fig. 7. AT92 A and C Schematic.


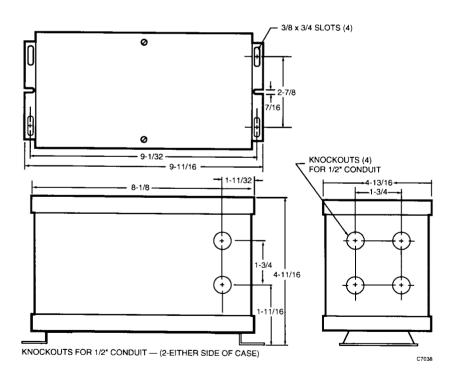


Fig. 6. AT92A, B, AND C Approximate Dimensions in Inches (Millimeters).

□ AT92B



This Class 1 Type A transformer is used in HVAC applications. The core and coils are potted in a heavy sheet metal box.

Electrical Ratings:

Primary Voltage 240/480V ac, 50/60 Hz Secondary voltages:

- 120V ac at 100 VA
- ☐ 240V ac at 100 VA

Connections: (See Fig. 8 for schematic)

Primary: Leadwires Secondary: Leadwires

Approval Bodies:

Underwriters Laboratories (UL) listed Canadian Standards Association (CSA) Approved

Dimensions:

See Figure 6.





Fig. 8. AT92B Schematic.

□ AT92C



This Class 1 Type A transformer is used in HVAC applications. The core and coils are potted in a heavy sheet metal box.

Electrical Ratings:

Primary Voltage

- ☐ 120/240/480V ac, 50/60 Hz
 - Secondary voltages:
- □ 17V ac at 175 VA
- 24V ac at 250 VA

Connections: (See Fig. 7 for schematic)

Primary: Leadwires Secondary: Leadwires

Approval Bodies:

Underwriters Laboratories (UL) listed Canadian Standards Association (CSA) Approved

Dimensions:

See Figure 6.

Honeywell

Home and Building Control

Honeywell Inc. Honeywell Plaza P.O. Box 524 Minneapolis, MN 55408-0524 **Home and Building Control**

Honeywell Limited-Honeywell Limitée 740 Ellesmere Road Scarborough, Ontario M1P 2V9 Helping You Control Your World