

Thermal equipment trip TAS Manual valve with thermal equipment trip AKT..TAS

Technical Information · GB

1 Edition 05.14I

- Isolate the gas pipeline in the event of a fire
- High thermal capacity
- AKT..TAS: two fittings in one housing
- EC type-tested and certified



Contents

Thermal equipment trip TAS	1
Manual valve with thermal equipment trip AKT..TAS .	1
Contents	2
1 Application	3
2 Examples of application	5
3 Certification	6
4 Function.....	7
5 Flow rate.....	8
6 Selection	9
6.1 Selection table for TAS.....	9
6.1.1 Type code for TAS.....	9
2 Project planning information	11
2.1 Installation.....	11
3 Accessories	11
4 Technical data	12
4.1 Dimensions	14
4.1.1 TAS.....	14
4.1.2 AKT..TAS	15
5 Maintenance cycles	16
Feedback.....	17
Contact.....	17

TAS: the thermal equipment trip shuts off pipelines safely up to 650°C.



TAS



AKT..TAS

AKT..TAS: the space-saving combination of a manual valve and a thermally tripping shut-off valve offers two functions in a single housing.

1 Application

Thermal equipment trips can be used in industrial and commercial installations, upstream of gas inlet systems, at gas cooker points, instantaneous water heaters and gas boilers. In the event of fire, they isolate the gas pipeline and provide long-term protection against the uncontrolled escape of gas and a potential explosion. Valves AKT..TAS and TAS can be used pursuant to the German Firing System Directive and TRGI (DVGW Code of Practice G 600).

TAS

Automatically closing safety device

AKT..TAS


Manual valve for manual shut-off, for gas, with automatically closing safety device

Application

*Thermal equipment trip TAS
15 – 25..M for biologically produced
methane*




*Manual valve with
thermal equipment trip AKT..TAS,
internal thread*

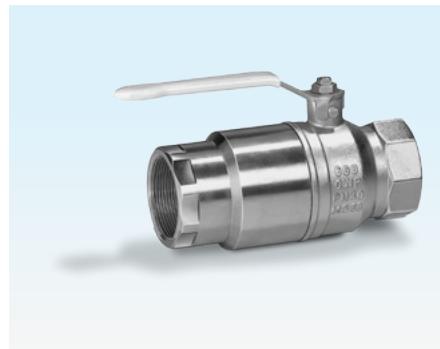


*Thermal equipment trip TAS
32 – 50IA, internal and external
threads*




*Manual valve with
thermal equipment trip AKT
25 – 150F50TAS,
flanged connection*

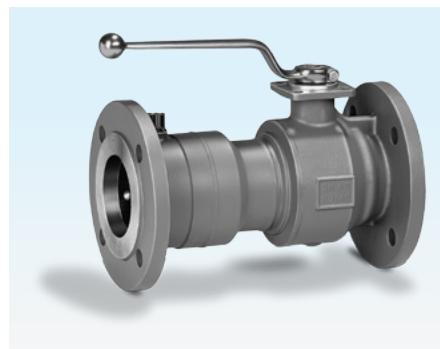

*Thermal equipment trip TAS
32 – 200FF,
flanged connection*

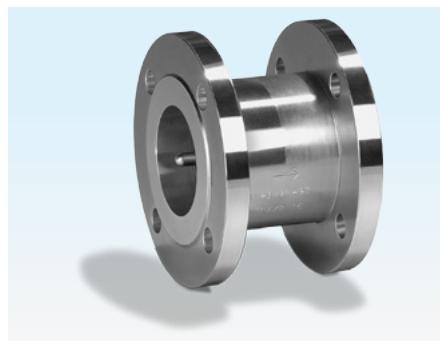

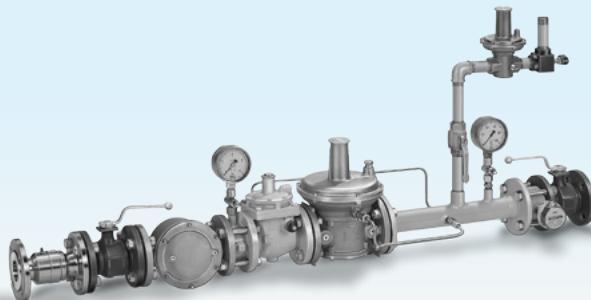

Gas pressure control (and measurement) system with TAS

2 Examples of application

When a thermal equipment trip TAS or a manual valve with thermal equipment trip AKT..TAS (pursuant to TRGI) is installed, the gas safety system features enhanced fire protection.

If the ambient temperature increases to more than 95°C in the gas pressure control (and measurement) system, the thermal equipment trip TAS trips and shuts off the gas supply safely.

In the application kitchen safety equipment with AKT..R10TAS/AKT..R40TAS and main gas shut-off device with AKT..F50TAS, the gas supply can be shut off manually at the inlet, in addition to the thermally tripping shut-off.

Reference standards

TRGI paragraph 5.1, "... fittings ... and measuring devices must be tight and designed in such a way that they do not lead to a risk of explosion in the event of exposure to an external fire."



Kitchen safety equipment with AKT..R10TAS/AKT..R40TAS



Main gas shut-off device with AKT..F50TAS

3 Certification

EC type-tested and certified pursuant to:



pursuant to

- Gas Appliances Directive (2009/142/EC)

AKT..R10TAS and AKT..R40TAS

- Manually operated ball valves and closed bottom tap plug valves for gas installations in buildings (DIN EN 331)
- Thermally activated shutting-off devices for gas – Requirements and testing (DIN 3586)

AKT..R10TAS

- DVGW test mark NG-4341BR0234
- Gas Appliances Directive CE-0085BR0233


AKT..R50TAS

- BVGW test mark NG 4341BU0538
- Gas Appliances Directive CE-0085BU0539

AKT..F50TAS

- DVGW test mark NG-4341AT2766
- Gas Appliances Directive CE-0085AU2378


4 Function

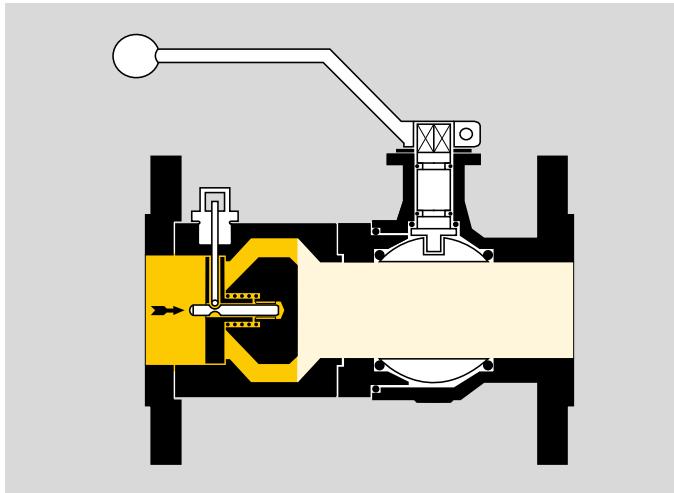

If the ambient temperature increases to more than 95°C in the event of a fire, a seal melts in the thermal equipment trip TAS and releases a spring that is held by a retaining pin. The spring presses the closing taper against the sealing seat ensuring that no more gas can pass through.

The valve can withstand temperatures of up to 650°C, which means that it remains tight for at least one hour.

5 Flow rate

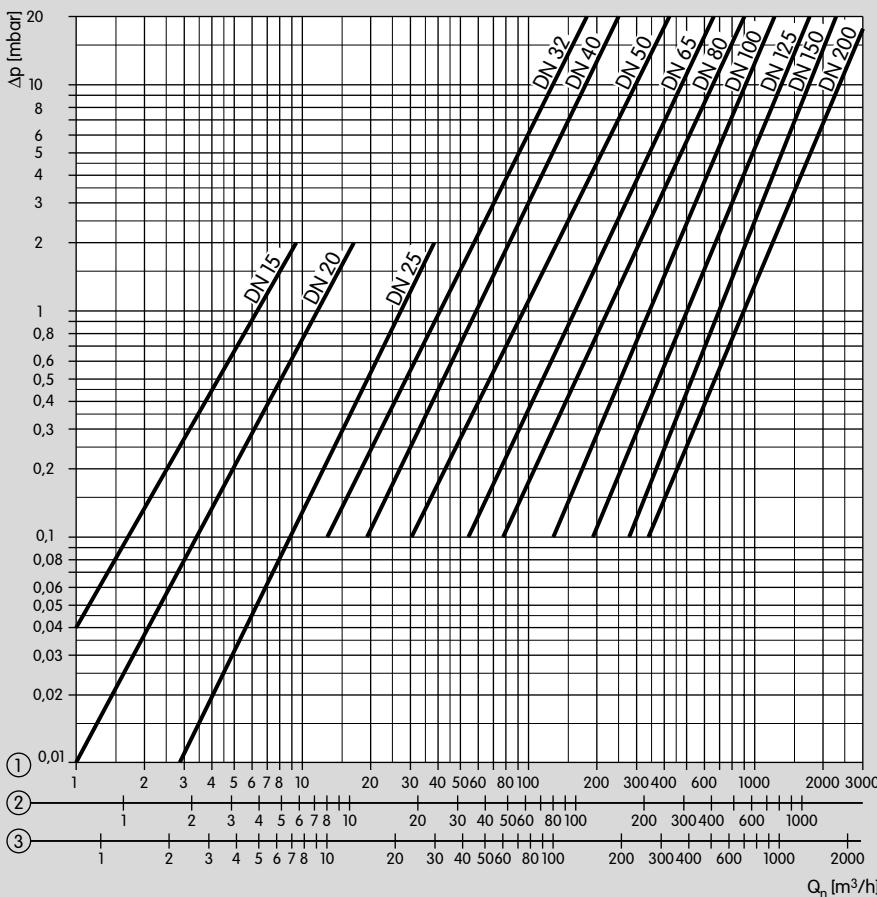

① = natural gas ($\rho = 0.62 \text{ kg/m}^3$)

② = LPG ($\rho = 1.56 \text{ kg/m}^3$)

③ = air ($\rho = 1.00 \text{ kg/m}^3$)

6 Selection

6.1 Selection table for TAS

Typ	15	20	25	32	40	50	65	80	100	125	150	200	I	F*	I	A	F	50	M	Order example
TAS..I				●	●	●							●		●	●		●		TAS 32IA50
TAS..F				●	●	●	●	●	●	●	●	●			●	●		●	●	
TAS..I..M	●	●	●	●	●	●	●							●		●		●	●	
TAS..F..M		●	●	●	●	●	●	●	●	●	●	●		●		●	●	●	●	

6.1.1 Type code for TAS

Code	Description
TAS	Thermal equipment trip
15...200	Nominal size
I F*	Inlet: Rp internal thread to ISO 7-1 PN 16 flanged connection to ISO 7005
I A F	Outlet: Rp internal thread to ISO 7-1 R external thread to ISO 7-1 PN 16 flanged connection to ISO 7005
50	Max. inlet pressure $p_{u\max}$, 5 bar
M	Suitable for biologically produced methane

* If the TAS installation set (available on request) is being used, the thermal equipment trips TAS..F meet the high thermal capacity requirements for inlet pressures of up to a max. of 16 bar.

Selection

Selection table for AKT..TAS

Typ	15	20	25	32	40	50	65	80	100	125	150	R	F	10	50**	TAS
AKT..R10	●	●	●									●		●		●
AKT..R50				●	●	●	●					●			●	●
AKT..F50		●	●	●	●	●	●	●	●	●	●		●		●	●

Order example

AKT 50R50TAS

Type code for AKT..TAS

Code	Description
AKT	Manual valve
15 ... 150	Nominal size
R F	Rp internal thread to ISO 7-1 PN 16 flanged connection to ISO 7005
10 50**	Max. inlet pressure $p_{u\ max.}$ / Max. operating pressure (GT*) with thermal capacity up to 650°C: 5 bar/1 bar (GT) 5 bar/5 bar (GT)**
TAS	Integrated thermal equipment trip

* Gas temperature resistance = GT

** If the TAS installation set (available on request) is being used, the manual valve with thermal equipment trip

AKT..F..TAS meets the high thermal capacity requirements for inlet pressures of up to a max. of 16 bar.

2 Project planning information

2.1 Installation

Installation position: any.

Wall clearance minimum 20 mm, note manual valve rotational radius.

AKT..TAS or TAS are to be installed immediately upstream of equipment that must not be exposed to thermal stresses or equipment that is not resistant to high temperatures.

Paint coatings, insulation, protective covers, etc. are not permitted.

Use high temperature resistant flange seals on the inlet side, see accessories.

3 Accessories

Flange seals for AKT..TAS

Use high temperature resistant flange seals on the inlet side, e.g. type WL-HT:

rubber seal made of NBR 50219.0, support ring made of ST 37, galvanized and chromized, coated with graphite on both sides and with red high temperature resistance label (HTB), seal material DVGW tested and registered.

4 Technical data

Types of gas:

natural gas, town gas and LPG (gaseous). Fuel gases in accordance with DVGW Code of Practice G 260.

Thermally controlled tripping at: 95°C, +/- 5°C.

Closing time: 60 s.

Duration of seal (HTR): minimum 60 minutes at 650°C.

Leakage: 30 l/h (at a test air pressure of 4 bar).

Ambient temperature: -20 to +60°C.

Thermal equipment trip TAS

In acc. with DIN 3586.

Inlet connection:

Rp internal thread to ISO 7-1,

PN 16 flanged connection to ISO 7005.

Outlet connection:

Rp internal thread and R external thread to ISO 7-1, PN

16 flanged connection to ISO 7005.

Housing: steel, galvanized.

TAS..M

For fuel gases in accordance with DVGW Code of Practice G 262.

Housing: steel, chemically nickel-plated.

Closing taper and closing spring: corrosion-resistant steel.

Threaded manual valve with thermal equipment trip AKT..R..TAS

MOP 5 (maximum over pressure) to EN 331.

Typ	Max. inlet pressure pu max. [bar]	Max. operating pressure GT* with thermal capacity up to 650°C [bar]
AKT 15R10TAS, AKT 20R10TAS, AKT 25R10TAS	5	GT1
AKT 32R50TAS, AKT 40R50TAS, AKT 50R50TAS	5	GT5

* Gas temperature resistance = GT

Rp internal thread to ISO 7-1.

AKT..R10TAS

Housing: brass, nickel-plated,

Ball: brass, chromium-plated,

Seal: PTFE (Teflon),

Spindle seal: Viton.

AKT..R50TAS

Manual valve housing: brass, chromium-plated,

TAS housing: steel, galvanized,

Ball: brass, chromium-plated,

Seal: PTFE (Teflon),

Spindle seal: Viton.

Technical data

Flanged manual valve with thermal equipment trip

AKT..F. TAS

PN 16 flanged connection to ISO 7005

Typ	Max. inlet pressure p_u max. [bar]	Max. operating pressure GT* with thermal capacity up to 650°C [bar]
AKT..50TAS	5	GT5

* Gas temperature resistance = GT

When using high temperature resistant screws (up to 650°C pursuant to DIN 267, Part 13), the max. inlet pressure p_u max. and the max. operating pressure GT increase to 16 bar.

Housing: GGG 40,


Ball: Ms58, chromium-plated,

Seal: PTFE (Teflon),

Spindle seal: Viton.


Overall length L pursuant to EN 558-1, line 1.

4.1 Dimensions

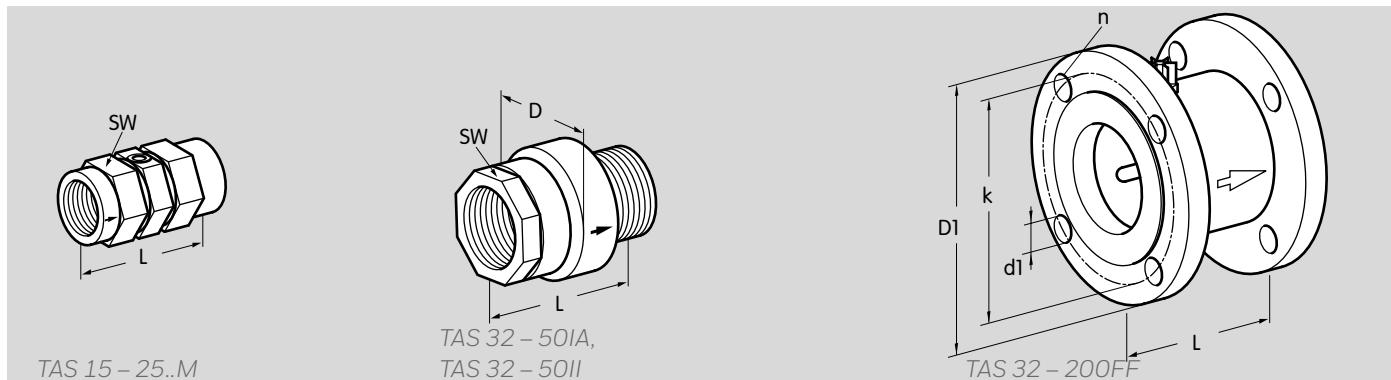


4.1.1 TAS

Type	Connection		L mm	A/F(SW) mm	D mm	Dimensions					Weight kg
	Inlet	Outlet				D1 mm	k mm	d1 mm	n		
TAS 15IA50M	Rp 1/2	R 1/2	46	27	—	—	—	—	—	—	0.1
TAS 15I50M	Rp 1/2	Rp 1/2	55	27	—	—	—	—	—	—	0.2
TAS 20IA50M	Rp 3/4	R 3/4	49	32	—	—	—	—	—	—	0.2
TAS 20II50M	Rp 3/4	Rp 3/4	61	32	—	—	—	—	—	—	0.2
TAS 25IA50M	Rp 1	R 1	56	41	—	—	—	—	—	—	0.3
TAS 25II50M	Rp 1	Rp 1	69	41	—	—	—	—	—	—	0.4
TAS 32IA50	Rp 1 1/4	R 1 1/4	90	50	63	—	—	—	—	—	0.7
TAS 32II50	Rp 1 1/4	Rp 1 1/4	90	50	63	—	—	—	—	—	0.8
TAS 32FF50	32	32	90	—	—	140	100	18	4	4.2	
TAS 40IA50	Rp 1 1/2	R 1 1/2	90	60	72	—	—	—	—	—	0.9
TAS 40II50	Rp 1 1/2	Rp 1 1/2	90	60	72	—	—	—	—	—	1.1
TAS 40FF50	40	40	90	—	—	150	110	18	4	4.5	
TAS 50IA50	Rp 2	R 2	110	70	85	—	—	—	—	—	1.4
TAS 50II50	Rp 2	Rp 2	110	70	85	—	—	—	—	—	1.5
TAS 50FF50	50	50	110	—	—	165	125	18	4	6.6	
TAS 65FF50	65	65	125	—	—	185	145	18	4	8.8	
TAS 80FF50	80	80	125	—	—	200	160	18	8	10.3	
TAS 100FF50	100	100	175	—	—	220	180	18	8	13.7	
TAS 125FF50	125	125	175	—	—	250	210	18	8	20.8	
TAS 150FF50	150	150	200	—	—	285	240	22	8	26.3	
TAS 200FF50	200	200	200	—	—	340	295	22	12	37.5	

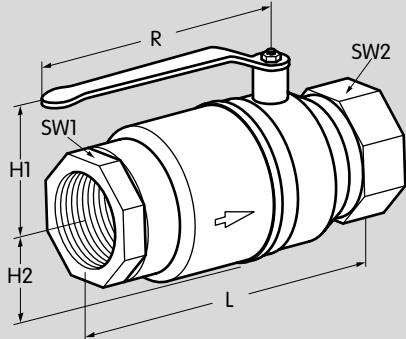

AKT 15 – 25R10TAS, AKT 32 – 50R40TAS

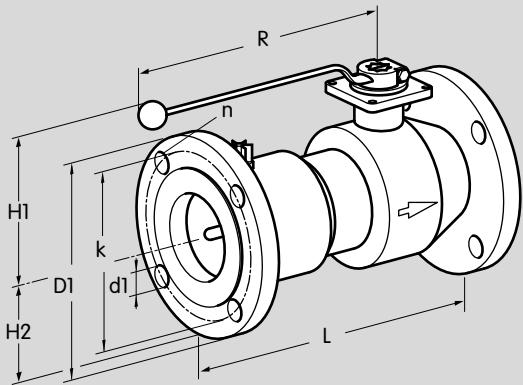

AKT 25 – 150F50TAS

4.1.2 AKT..TAS

Type	Connection	Dimensions												Weight kg
		L mm	A/F1 (SW1) mm	A/F2 (SW2) mm	H1 mm	H2 mm	R mm	D1 mm	k mm	d1 mm	n			
AKT 15R10TAS	Rp ½	84	25	25	42	16	100	-	-	-	-			0.3
AKT 20R10TAS	Rp ¾	96	31	31	45	20	100	-	-	-	-			0.4
AKT 25R10TAS	Rp 1	109	41	41	54	23	120	-	-	-	-			0.7
AKT 25F50TAS	25	160	-	-	114	58	165	115	85	14	4			4.0
AKT 32R50TAS	Rp 1¼	146	48	50	58	30	121	-	-	-	-			1.3
AKT 32F50TAS	32	180	-	-	125	70	165	140	100	18	4			5.9
AKT 40R50TAS	Rp 1½	151,5	54	55	73	36	159	-	-	-	-			1.8
AKT 40F50TAS	40	200	-	-	136	75	185	150	110	18	4			7.0
AKT 50R50TAS	Rp 2	185,5	66	70	81	43	159	-	-	-	-			2.9
AKT 50F50TAS	50	230	-	-	143	83	185	165	125	18	4			8.8
AKT 65F50TAS	65	290	-	-	158	93	230	185	145	18	4			15.8
AKT 80F50TAS	80	310	-	-	186	100	360	200	160	18	8			19.0
AKT 100F50TAS	100	350	-	-	203	110	360	220	180	18	8			27.5
AKT 125F50TAS	125	400	-	-	223	225	360	250	210	18	8			50.5
AKT 150F50TAS	150	480	-	-	230	143	625	285	240	22	8			71.0

5 Maintenance cycles

TAS and AKT..TAS require little servicing. After tripping,
the valves have to be replaced.

Feedback

Finally, we are offering you the opportunity to assess this “Technical Information (TI)” and to give us your opinion, so that we can improve our documents further and suit them to your needs.

Clarity

- Found information quickly
- Searched for a long time
- Didn't find information
- What is missing?
- No answer

Comprehension

- Coherent
- Too complicated
- No answer

Scope

- Too little
- Sufficient
- Too wide
- No answer



Use

- To get to know the product
- To choose a product
- Planning
- To look for information

Navigation

- I can find my way around
- I got “lost”
- No answer

My scope of functions

- Technical department
- Sales
- No answer

Remarks

Contact

Elster GmbH
Postfach 2809 · 49018 Osnabrück
Strotheweg 1 · 49504 Lotte (Büren)
Germany
Tel +49 541 1214-0
Fax +49 541 1214-370
info@kromschroeder.com
www.kromschroeder.com

The current addresses of our international agents
are available on the Internet:
www.kromschroeder.de/Weltweit.20.0.html?&L=1

We reserve the right to make technical
modifications in the interests of progress.
Copyright © 2016 Elster GmbH
All rights reserved.

Honeywell
kromschroder